



PRODUCT DATA SHEET

AUTOMATIC BYPASS VALVE

ABBV1

REGULATES HEATING SYSTEM DIFFERENTIAL PRESSURE

HIGH CAPACITY FLOW UP TO 50 LITRES PER MINUTE

DIFFERENTIAL PRESSURE RANGE 0.1 TO 0.6 BAR

22MM COMPRESSION FITTING



The Tower ABBV1 should be fitted where a boiler bypass is required. Typically this is the case when a system is equipped with thermostatic radiator valves (TRV's), and to allow pump overrun operation after zone valves have closed down.



TRV's slowly close down as each radiator raises the room temperature. To overcome Flow restriction as TRV's close down, the ABBV1 is adjusted to the required set point.

As the system resistance increases due to TRV's closing, the ABBV1 allows flow to Increase in order to maintain the required pre-set system differential pressure . The regulation provided will reduce system noise that can result from TRV's or zone valves closing, eliminate pump impeller wear that can result from high flow resistance and enhance the life of the boiler's heat exchanger by ensuring minimum flow rate at all times.

Installation should be in a loop between flow and return after the pump. Ensure that the flow is in the direction of the arrow on the ABBV1 body. Rotate the adjustment head until the required setting number is visible, and lock the valve at that point by tightening the screw on top of the adjuster. Refer to recommendations in the boiler instructions and the pressure /flow rates detailed below to decide which setting is required.

Specification:

- High capacity flow up to 50 litres per minute
- Wide differential pressure range 0.1 bar to 0.6 bar
- 22mm Compression fittings
- Reduces system noise
- Maintains an even system pressure
- Constant flow through boiler
- Lockable set pressure

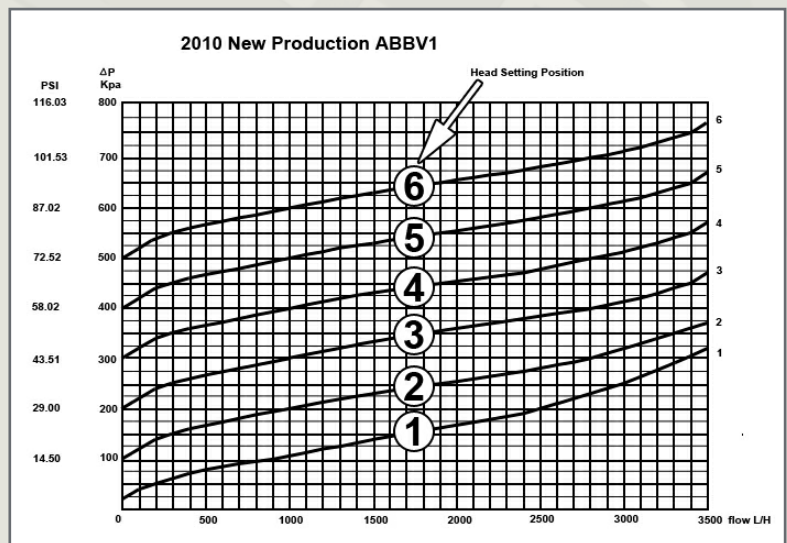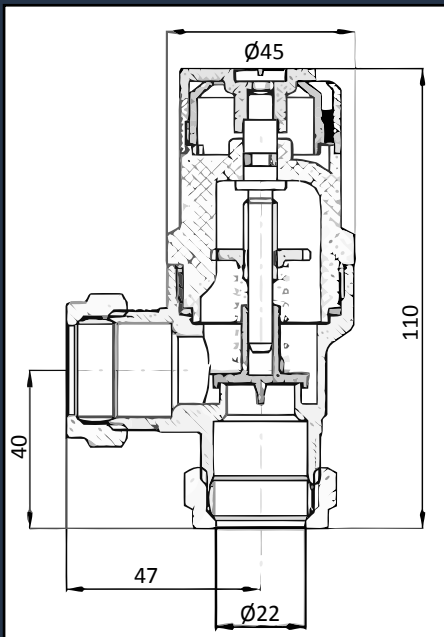

TFC GROUP LLP

ABBV1 AUTOMATIC BYPASS VALVE - 22mm



Cert No: RS 30178
QR057

TFC GROUP LLP, TOWER HOUSE, VALE RISE, TONBRIDGE, KENT TN9 1TB

Tel: 01732 351680 Fax: 01732 354445 www.tfc-group.co.uk

Prepared for TFC Group LLP By: M. Edmonston

Issue 1: July 2018

Page 1 of 1